




EuroSun2018


12th International Conference on
Solar Energy for Buildings and Industry

September 10-13, 2018 | Rapperswil, Switzerland

In cooperation with:

SWISSOLAR  7th Swissolar
Solar Heating Conference

SIGES  2nd SIGES Conference on the Simulation
of Building-Integrated Energy Systems

SAC 2018  8th International Conference
on Solar Air Conditioning

www.eurosun2018.org

Proceedings of the ISES EuroSun 2018 Conference – 12th International Conference on Solar Energy for Buildings and Industry

Editor

Dr. Andreas Häberle
EuroSun 2018, Chair of the Scientific Committee

Copyright © 2018 by the International Solar Energy Society and the Authors

*International Solar Energy Society
Wiesentalstr 50
79115 Freiburg
Germany*

Tel + 49 761 45906 – 0
Fax + 49 761 45906 – 99
Email hq@ises.org
Web <http://www.ises.org>

ISBN 978-3-9820408-0-6

All rights reserved. No part of the publication may be reproduced, transmitted, in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without permission of the publisher, except in the case of brief quotations embodied in critical articles and review or where prior rights are preserved.

Produced by

International Solar Energy Society and PSE Conferences and Consulting GmbH

Notice

The International Solar Energy Society, the HSR Hochschule für Technik Rapperswil (Technical University of Rapperswil), PSE Conferences and Consulting GmbH or any one of the supporters or sponsors of the EuroSun 2018 makes any warranty, express or implied, or accepts legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately on rights of others. The contents of articles express the opinion of the authors and are not necessarily endorsed by the International Solar Energy Society, the HSR Hochschule für Technik Rapperswil (Technical University of Rapperswil), PSE Conferences and Consulting GmbH or by any of the supporters or sponsors of the EuroSun 2018. The International Solar Energy Society, the HSR Hochschule für Technik Rapperswil (Technical University of Rapperswil) and PSE Conferences and Consulting GmbH do not necessarily condone the politics, political affiliation and opinions of the authors or their sponsors.

We thank our Sponsors and Supporters!

Silver Sponsors:

The logo for Hoval, consisting of the word "Hoval" in white text on a red rectangular background.The logo for polysun, with "polysun" in a grey sans-serif font and "SIMULATION SOFTWARE" in a smaller orange font below it.

Bronze Sponsors:

Promoter:

The logo for ABSOLICON, featuring a stylized blue and white icon of a solar collector and the text "ABSOLICON SOLAR COLLECTORS".The logo for Jinko Solar, with "Jinko" in green and "Solar" in a smaller font, and the tagline "Building Your Trust in Solar" below.The logo for sti, with "sti" in a bold font and a cluster of orange dots to its right. Above it, the text "SOLAR ENERGY INSTITUTE INTERNATIONAL GUSTAV" is visible.The logo for VÖGELIN, featuring a stylized bird icon and the text "VÖGELIN ENERGIE- UND SOLARTECHNIK GmbH".The logo for Energicstadt Rapperswil-Jona, with a blue silhouette of a city and the text "Energicstadt Rapperswil-Jona" and "ist gut unterwegs" below.

Hosts:



A Conference of:

The logo for HSR, with "HSR" in a large font and "HOCHSCHULE FÜR TECHNIK RAPPERSWIL" and "FHO Fachhochschule Ostschweiz" below.The logo for SWISSOLAR, with "SWISSOLAR" in a bold font and a stylized sun icon to its right.The logo for ISES, with a globe icon and the text "ISES International Solar Energy Society".

Supporters:

Conference Organizer:

Online Management:

The logo for SFOE, with a red cross icon and the text "Schweizerische Eidgenossenschaft Confédération suisse Confederazione Svizzera Confederaziun svizra" and "Swiss Federal Office of Energy SFOE" below.The logo for swissenergy, with a stylized 'e' icon and the text "swissenergy" and "Our commitment: our future." below.The logo for SPF, with a stylized 'S' icon and the text "SPF INSTITUT FÜR SOLARTECHNIK" below.The logo for PSE, with a cluster of blue dots and the text "PSE Powering Scientific Exchange" below.The website address "www.eurosun2018.org" displayed in white text on a dark background.



EuroSun2018

12th International Conference on
Solar Energy for Buildings and Industry

Program Overview

Monday September 10, 2018	Tuesday September 11, 2018	Wednesday September 12, 2018	Thursday September 13, 2018
08:30 ...	Room 3.011	Room 3.011	Room 3.011
09:00 ...	Room 3.010	Room 3.010	Room 3.010
09:30 ...	Room 3.008	Room 3.008	Room 3.008
10:00 ...	Aula	Aula	Aula
10:30 ...	Opening Session (Aula)	Keynote Lectures (Aula)	Keynote Lectures (Aula)
11:00 ...	Keynote Lectures (Aula)	Coffee Break	Solar Resource
11:30 ...	Keynote Lectures (Aula)	Solar Resource	Collectors Components
12:00 ...	Poster Session 1 (1 st floor building 1 + Rooms 4.112/4.113)	Process Heat	Hot Water Space Heating
12:30 ...	Lunch	Education	SAC
13:00 ...	Lunch	Poster Session 2 (1 st floor building 1 + Rooms 4.112/4.113)	Strategies Policies
13:30 ...	Lunch	SAC	Collectors Components
14:00 ...	PV / PVT	Solar Resource	District Heating
14:30 ...	Thermal Storage	Process Heat	SAC
15:00 ...	Solar Buildings	SIGES	Closing Session (Aula)
15:30 ...	Swissolar Solar Heating Conference	SAC	Technical Tours
16:00 ...	Coffee Break	Hot Water Space Heating	Polysun Workshop 3 (Room 8.U44a)
16:30 ...	PV / PVT	SIGES	Polysun Workshop 4 (Room 8.U44b)
17:00 ...	Workshop: Breaking the Vicious Circle of Poverty in the Nepal Himalayas (Room 5.002)	SAC	Workshop: Results of IEA SHC Task 54 (Room 5.002)
17:30 ...	Welcome Reception	ESTTP Workshop (Room 5.002)	
18:00 ...	Pre-Registration	Happy Hour	
18:30 ...	Young ISES Welcome	Conference Dinner	
19:00 ...			
19:30 ...			

Editorial

Editorial to the Proceedings of EuroSun 2018

Häberle, A, Stickelberger, D., Streicher, W., Renne, D. 1

Scientific Program

Solar Buildings

Evacuated Glazing with Silica Aerogel Spacers

Büttner, B., Beck, A., Buck, D., Heinemann, U., Nauschütz, J., Reichenauer, G.,
Scherdel, C., Weinläder, H., Weismann, S. 5

Radiative Cooling to Cover Cooling Demands of an Earthbag Building in a Training Medical Center in Burkina Faso

Castell, A., Carrobé, A., Martorell, I., Medrano, M., Rincón, L., Vall, S. 13

Definition of a Reference Office Building for Simulation Based Evaluation of Solar Envelope Systems

D'Antoni, M., Bonato, P., Fedrizzi, R., Geisler-Moroder, D., Loonen, R.C.G.M.,
Magni, M., Ochs, F.E., de Vries, S. 19

Building Integrated Photovoltaic Systems – Energy Production Modelling in Urban Environment

Govehovitch, B., Giroux-Julien, S., Ménézo, C., Peyrol, E. 29

The SOLAR DECATHLON Knowledge Platform – Concept and Initial Application

Hendel, S. 41

Difference in Evaluation of Discomfort Glare from Windows between Middle-Eastern and Japanese Students

Iwata, T. 51

Energy Efficient & Sustainable Buildings in Qatar & Integration of Solar Assisted Air-Conditioning Technology – a Step Towards Grid Free Zero Carbon Living

Khan, M., Hassabou, A., Heithorst, B., Spinnler, M. 61

Energy Performance Investigation of Energy-Plus Solar House Integrated Renewable Energy Systems

Kim, M. 71

Control Strategies for a Residential Property with Solar Building, Thermal and Electricity Storages

Korvola, T., Abdurafikov, R., Reda, F. 77

Modular Rooftop Building-Integrated Photovoltaic/Thermal Systems for Low-Rise Buildings in India	
<i>Kruglov, O., Athienitis, A., Bagchi, A., Ge, H., Lee, B., Rounis, E., Stathopoulos, T.</i>	89
Semi-Virtual Tests of a System Using Exhaust Air, Grey Water and Solar Heat for Domestic Hot Water and Space Heating Needs of a Multifamily House	
<i>Leconte, A., Moureaux, S.</i>	98
Thermal Monitoring on an Earthbag Building in Mediterranean Continental Climate	
<i>Martorell, I., Carrobé, A., Medrano, M., Rincón, L., Solé, C.</i>	109
Solar Seminar Room in the University of Balearic Islands with a New Advanced Radiant System	
<i>Moià-Pol, A.</i>	116
bFAST: A Methodology for Assessing the Solar Potential of Façades in Existing Building Stocks	
<i>Polo López, C.S., Corti, P., Frontini, F., Polo Lopez, C.S., Saretta, E.</i>	122
High Solar Fraction By Thermally Activated Components	
<i>Ramschak, T., Becke, W., Fink, C., Heimrath, R., Lerch, W., Mach, T.</i>	133
Early Design Stage Consideration of Building Form and BIPVT Energy Performance	
<i>Yip, S., Athienitis, A., Lee, B.</i>	140
An Aesthetic Energy Producing Roof with Integration of PV Modules and Solar Thermal Collectors	
<i>de Keizer, C., Rindt, C., de Jong, M., van Diemen, R., van Paassen, M., van de Voort, R.</i>	149

Solar Assisted District Heating and Cooling

Comparison of Solar District Heating Concepts at Various Land Prices	
<i>Best, I., Orozaliyev, J., Vajen, K.</i>	156
Energetic and Economic Analysis of a Solar-Assisted Trigeration System	
<i>D'Antoni, M., Fedrizzi, R.</i>	168
Thermo-Chemical District Networks	
<i>Koller, C., Bergmann, T., Danesi, S.</i>	178
Distributed vs Centralized Solar District Systems. Study Case in Balearic Islands Districts	
<i>Moià-Pol, A., Sabater, P.</i>	187
Development of a Software System for Optimal Operation of Heating Networks with Central Solar Plant	
<i>Oppelt, T., Frey, H., Göschel, T., Heinrich, I., Otto, S., Schmidt, A., Uhlig, U., Urbaneck, T.</i>	195
Opportunities for the Integration of Solar Thermal Heat, Photovoltaics and Biomass in a Brazilian Hospital	
<i>Pina, E.A., Lozano, M.A., Serra, L.M.</i>	200
Experimental Plant for Analyzing the Technical Feasibility of Decentralized Solar Heat Feed-In	
<i>Schäfer, K.</i>	212

Solar Heat for Industrial Processes

Optical Analysis of an Evacuated Tube Collector with Built-In Semicircular Concentrator for Process Heat Applications	
<i>Christodoulaki, R., Drosou, V., Tsekouras, P.</i>	222
Environmental Assessment of Industrial Solar Thermal Systems	
<i>Fokaides, P., Ioannides, A., Jurelionis, A., Kalogirou, S., Kyllili, A., Souliotis, M., Valancius, R.</i>	229
RESSSPI: The Network of Simulated Solar Systems for Industrial Processes	
<i>Frasquet, M., Nel, Y., Silva, M., bannenberg, J.</i>	239
Cleaning Strategies for Fresnel Linear Concentrator Mirrors in Solar Heating Plants	
<i>Gabbrielli, R., Del Medico, F., Di Palo, M., Gulino, G.</i>	248
Solar Heat in Industrial Processes in Switzerland - Theoretical Potential and Promising Sectors	
<i>Guillaume, M., Bunea, M.S., Caflich, M., Martin, J., Rittmann-Frank, M.H.</i>	257
Solar Heat Integration in Rotational Molding Process: Case Study	
<i>Laadel, N.E., Agalit, H., Bennouna, E.G., Mouaky, A.</i>	268
Standardisation of Solar Process Heat Applications to Increase Market Penetration	
<i>Schmitt, B., Jesper, M., Pag, F., Ritter, D., Vajen, K., Wimmer, L.</i>	279
Thermal Analysis and Validation of a Geodesic Dome Dryer for Capsicum Baccatum	
<i>Vergara, S., Hadzich, M., Herrera, E., Lopez Vasquez, E., Perez, J., Tipula, R.</i>	290

Domestic Hot Water and Space Heating

Efficient Design of Solar Assisted Heating Systems for Multi-Family Houses	
<i>Backes, K., Adam, M., Eggert, D., Götzelmann, D., Helbig, S., Wirth, H.P.</i>	301
Energetic Behaviour of a Solar Thermal System Producing Domestic Hot Water and Preheating the Ventilation Air	
<i>Carbajo Jiménez, P., Fraise, G., Leconte, A., Ouvrier Bonnaz, O., Wurtz, E.</i>	310
Comparative Dynamic Performance Tests of Two Real Technology Packages for Buildings Heating System Retrofit	
<i>Chèze, D., Fuligni, F., Nicolas, L., Patric, B.</i>	322
Drainback Solar Thermal Systems in Switzerland – Market Overview and Main Barriers	
<i>Eicher, S., Bony, J., Bunea, M., Citherlet, S., Guillaume, M.</i>	334
Experimental Analysis of Air-Water Heat Exchanger with Microchannel Coil Exposed to Different Working Parameters	
<i>Glazar, V., Kirini, M., Leni, K., Trp, A.</i>	345
Hardware-In-The-Loop Tests on Complete Systems with Heat Pumps and PV for the Supply of Heat and Electricity	
<i>Haberl, R., Bamberger, E., Haller, M., Reber, A.</i>	357
Sustainability Assessment of Most Relevant Solar Thermal Heat Systems	
<i>Kicker, H., Lang, R.W., Wallner, G.M.</i>	367

Artificial Intelligence for the Efficient Control of Solar Heating Systems <i>Kramer, W.</i>	377
Simulation-Based Optimization of Solar Combisystem. Sensitivity Analysis at Optimum <i>Kusyy, O., Vajen, K.</i>	385
Measurement Evaluation and Simulation of an Innovative Drainback Solar Combi-System <i>Louvet, Y., Orozaliev, J., Vajen, K.</i>	397
Simulation and Monitoring of PV Heat Pump System with Seasonal Storage <i>Matuska, T., Broum, M., Sourek, B.</i>	409
Towards Automated Continuous Performance Benchmarking of DHW and Combi Systems <i>Schmelzer, C., Georgii, M., Kusyy, O., Orozaliev, J., Vajen, K.</i>	418
Single Source “solar Thermal” Heat Pump for Residential Heat Supply: Performance with an Array of Unglazed PVT Collectors <i>Schmidt, C., Schäfer, A.</i>	426
Polymer Collectors with Temperature Control - Thermosiphon Valve Development and System Integration <i>Thür, A., Hauer, N., Schroll, J.</i>	438
Review of Combined Solar Thermal and Heat Pump Systems Installations in Lithuanian Hospitals <i>Valancius, R., Cerneckiene, J., Singh, R.M.</i>	444
Solar Thermal Systems VS. Photovoltaic Systems. Case Study: Single Family Building in Lithuania <i>Valancius, R., Cerneckiene, J., Fokaides, P., Jurelionis, A., Vaiciunas, J.</i>	449
Space Cooling Application with Unglazed Solar Absorber <i>Wemhoener, C., Schwarz, R.</i>	455
The Development of the Sunridge, an Orientation Independent Thermal Solar System <i>de Geus, A., de Beijer, H.</i>	463
Direct Solar Thermal Systems with Thermosiphon Frost Protection and Innovative Control Strategies Using a Thermo-Differential Bypass Valve <i>van Ruth, N., Kratz, P.</i>	474

Solar Air Conditioning and Refrigeration (8th International Workshop on Solar Air Conditioning)

Selection of High-Performance Working Fluid for a Solar-Geothermal Absorption Cooling System and Techno-Economic Study in the Northern Mexican Conditions <i>Altamirano Cundapí, A., Le Pierrès, N., Stutz, B.</i>	481
Life Cycle Assessment Experiences for Solar Heating and Cooling Systems <i>Beccali, M., Cellura, M., Cusenza, M.A., Longo, S., Mugnier, D., Selke, T., Vicente Quiles, P.G.</i>	493
Monitoring and Energy Performance Assessment of the Compact DEC HVAC System “Freescoo Facade” in Lampedusa (Italy) <i>Beccali, M., Di Pietra, B., Finocchiaro, P., Motta, M.</i>	505

Modelling of an Absorption Cycle With a Direct Ammonia Vapor Generator Inside a Concentrating Parabolic Trough Solar Collector	
<i>Celik, S.B., Famiglietti, A., Lecuona Neuman, A., Rodrigues Aumente, P.A.</i>	513
Modelling and Simulation of a PV Driven Refrigerator with Phase-Change Materials in the Internal Walls	
<i>Coca-Ortegón, A., Coronas, A., Müller, J., Torres, V.</i>	524
Simulations of Solar Thermal Cooling System for a Building at Innovation Park Muscat	
<i>Cordes, T., Al-Riyami, S., Scheuren, J., Schlatmann, R.</i>	536
Simulation of a Solar Fired Absorption System for a Case Study in the Dairy Industry	
<i>Correa-Jullian, C., Cortés, F., Crespo, A., Ibarra, M.</i>	544
Design and Construction of a 10 KW Sorption Heat Pump Prototype	
<i>Daguenet-Frick, X., Gantenbein, P., Haeblerle, A., Persdorf, P.</i>	554
Development of a Photovoltaic Driven Thermodynamic Chiller – Application to Solar Air Conditioning And Cooling Storage	
<i>Esparcieux, P., Baup, O., Marvillet, C., Mugnier, D., Weber, C.</i>	562
Measurement Results and Operating Experience of Large-Scale Solar Air Conditioning Plants	
<i>Feierl, L., Holter, C., Poier, H.</i>	574
Experimental Investigation on the Dynamic Performance of a Thermally-Driven Adsorption Chiller Integrated with a Gas Boiler	
<i>Fuentes, E., Balsells, M., Bellanco, I., Impala, V., Mogro, O., Salom, J., SanJoaquín, S., Sayans, A.</i>	585
PV Driven Dew-Point Cooling for Australia	
<i>Goldsworthy, M., Sethuvenkatraman, S.</i>	597
Experimental Comparison of Scroll and Swash-Plate Compressors for PV Driven Compression Chillers and Heat Pumps	
<i>Heithorst, B., Bauer, G., Irrgang, L., Rauscher, B., Sattelmayer, T., Spinnler, M.</i>	609
Design and Practical Validation of a Hybrid Absorption/Compression Chiller Driven by Low-Grade Heat	
<i>Helm, M., Eckert, T.</i>	621
Modified Solar-Assisted Ejector Cooling System	
<i>Huang, B., Ko, H.</i>	633
Levelised Cost of Thermal Energy Storage and Battery Storage to Store Solar PV Energy for Cooling Purpose	
<i>Luerssen, C., Cheong, K.W.D., Gandhi, O., Reindl, T., Sekhar, C.</i>	638
Comparison of Modeled and Measured Heat and Mass Transfer in a Liquid Desiccant Air-Conditioning System	
<i>Mandow, W., Fleig, D., Jordan, U., Lowenstein, A., Mützel, M., Vajen, K.</i>	648
Development of Solar Assisted Sorption Unit for Extraction of Water from Ambient Air in Desert Climate	
<i>Matuska, T., Sourek, B., Zmrhal, V.</i>	659
Using the Heat of Sun to Cool: A Case Study of 100 TR (350kWth) Solar Air-Conditioning System	
<i>Mehta, K., Gadhia, D.</i>	665

Technical and Economic Performance of Best Practice SHC Plants – A Compilation of IEA SHC Task 53 Results	
<i>Neyer, D., Köll, R., Mugnier, D.</i>	673
Experimentally Validated Dynamic Model for a Hybrid Cascade System for Solar Heating and Cooling Applications	
<i>Palomba, V., Frazzica, A., Große, A., Kühnert, S.</i>	684
Performance Analysis of a Small Scale Solar Cooling Plant Based on Experimental Measurements	
<i>Pellegrini, M., Bianchini, A., Guzzini, A., Saccani, C.</i>	692
New Water Adsorbent for Adsorption Driven Chillers	
<i>Risti, A., Krajnc, A., Zabukovec Logar, N.</i>	704
Efficient Solar Driven Air Conditioning System for Hot Climates: Case Study of Doha	
<i>Tamainot-Telto, Z.</i>	710
Performance Investigation of Liquid Desiccant Dehumidification System Integrated with Solar Thermal Energy and Shallow Geothermal Energy	
<i>Tseng, C., Chen, S., Liang, J., Yang, L.</i>	716
Application of PCM in Building's Envelope of Lightweight Prefabricated Houses as an addition to a PV driven renovation cooling system by EU project HEART	
<i>Zavrl, E., Dovjak, M., Stritih, U., Zupanc, G.</i>	728

PV and PVT Systems for Buildings and Industry

Field Test Results of an Innovative PV/T Collector for an Outdoor Swimming Pool	
<i>Brottier, L., Bennacer, R.</i>	738
Performance Assessment of a Photovoltaic-Thermal Roof	743
Electrical and Thermal Performance Evaluation of a District Heating System Composed of Asymmetric low concentration PVT Solar Collector Prototypes	
<i>Cabral, D., Costeira, J., Gomes, J.</i>	755
Potential of Covering Electricity Needs of a Flat of a MFH with Decentral Compact Heat Pumps with PV – Simulation Study for Different DHW Profiles and PV Field Sizes	
<i>Calabrese, T., Dermentzis, G., Siegele, D.</i>	764
Assessment of the Suitability of Different Photovoltaic Cell Technologies for Product Development of Building Integrated Solutions Using the Hierarchy Process (ahp)	
<i>Haghighi, Z., Isabella, O., Konstantinou, T., Ortiz Lizcano, J.C., Zeman, M., van den Dobbelsteen, A.</i>	774
Economic Feasibility of Solar PV System for Buildings	
<i>Huang, B., Hsu, P.C.</i>	784
Comparative Economic Analysis of Single and Dual-Fluid Based Photovoltaic Thermal Systems for Building Energy Needs	
<i>Hussain, M.I.</i>	788
Implementation and Experimental Validation of a Photovoltaic-Thermal (PVT) Collector Model in TRNSYS	
<i>Jonas, D., Frey, G., Theis, D.</i>	798

Numerical Simulation of the Thermal Performance of Four Prototypes of CPC Collectors That Use Bifacial PV Cells	
<i>Lança, M., Gomes, J., Hayati, A.</i>	810
Organic PVT - A Novel Hybrid Collector Combining Organic Photovoltaics and Polymer Absorbers	
<i>Lämmle, M., Hernandez Gonzalez, H., Li, C., Meir, M., Piekarczyk, A., Pita Bauermann, L., Rekstad, J.</i>	822
Degradation of photovoltaic systems based on long-term measurements and laboratory tests	
<i>Muntwyler, U., Schott, T.</i>	828
Development and Field Testing of a Novel Hybrid PV-Thermal Solar Collector	
<i>Murrell, A., Alonso Alvarez, D., Ekins-Daukes, N., Mellor, A., Povall, S., Williams, C.</i>	835
Study on Distributed MPPT System in Solar EV	
<i>Nemoto, Y., Fujisawa, T.</i>	841
Glazed PVT Collector Integrated Into Façade Module	
<i>Pokorny, N., Jirka, V., Matuska, T., Sourek, B.</i>	850
Design and Performance Assessment of a Prefabricated BIPV/T Roof System Coupled with a Heat Pump	
<i>Rounis, E.D., Athienitis, A., Dumoulin, R., Ioannidis, Z., Kruglov, O., Stathopoulos, T.</i>	859
Solar Hybrid PVT Coupled Heat Pump Systems Towards Cost-Competitive NZEB	
<i>Sanz Martinez, A., Fuente Dacal, R., Martín Miranda, A.J.</i>	869
Experimental Performance Evaluation of PV/T Panels at Negative Reduced Temperatures	
<i>Simonetti, R., Manzolini, G., Molinaroli, L.</i>	881
Experimental Investigation of PVT Collectors with Phase Change Material	
<i>Simón, R., Brun, G., Guedea, I., Villén, R.</i>	891
A Techno-Economic Comparison Between PV and PVT Integrated Ground Source Heat Pumps for Multi-Family Houses	
<i>Sommerfeldt, N., Madani, H.</i>	901
Multi-Objective Optimization of a Solar Heat Pump System Using PVT and Ice-Based Latent Storage	
<i>Tamasauskas, J., Poirier, M., Zmeureanu, R.</i>	911
PV Power Production Estimation by Using Radiometric and Meteorological Data	
<i>Trigo, M., Alonso-Montesinos, J., Batlles, F.J., Cortés, M., Ferrada, P., Martinez-Durbán, M., Marzo, A., Portillo, C., Rosiek, S.</i>	923
Improvements on the Efficiency of the Photovoltaic Panel by Integrating a Spray Cooling System with Shallow Geothermal Energy Heat Exchanger	
<i>Yang, L., Chen, S., Liang, J., Tseng, C.</i>	930
Extended Hottel-Whillier Models for uncovered PVT-Collectors	
<i>Zenhäusern, D., Battaglia, M.</i>	941
An Overview of PVT Modules on the European Market and the Barriers and Opportunities for the Dutch Market	
<i>de Keizer, C., Bottse, J., Folkerts, W., de Jong, M.</i>	949

Solar Thermal Collectors and Solar Loop Components

Annual Efficiency - Easy Understanding of Collector Performance <i>Abrecht, S.</i>	956
Assessment of Durability of Solar Absorbers - Performance Criterion <i>Carvalho, M.J., Diamantino, T., Páscoa, S.</i>	964
Accelerated Aging Tests for Solar Absorber Coatings <i>Diamantino, T., Carvalho, M.J., Chambino, T., Ferreira, C., Gonçalves, R., Nascimento, I., Páscoa, S.</i>	973
Influence of Using Different SiO₂ Antireflective Coatings and Sintering Conditions on the Durability and Optical Performance of the Selective Solar Absorber <i>Farchado, M., Germán, N., Morales, Á., San Vicente, G.</i>	983
Testing and Modeling of Direct Steam Generating Parabolic Trough Collectors <i>Ferchichi, S., Ben Cheikh, R., Bouden, C., Castro, J., Kessentini, H., Morales, S., Oliveira, A., Soares, J., Willwerth, L.</i>	994
Basic Study on Flow Stabilization of Top-Heat-Type Thermosiphon <i>Fujisawa, T., Kawaguchi, T.</i>	1006
Ray Tracing Method for the Evaluation of Yearly Performance of a Solar Thermal Concentrator <i>García, H., Delgado, O., Gutierrez, A., Ramirez, C.</i>	1017
Tailoring Alumina Matrix Optical Properties for Colored Solar Thermal Absorber Coatings <i>Isac, L., Duta, A., Perniu, D.</i>	1025
Experimental Investigations on the Stagnation Behavior of Thermochromic Flat Plate Collectors <i>Müller, S., Giovannetti, F., Hafner, B., Reineke-Koch, R.</i>	1032
Theoretical Analysis of Combined Solar System Based on Dual Purpose Solar Collector <i>Pokorny, N., Matuska, T., Shemelin, V., Sourek, B.</i>	1043
Solar Flux Map Distribution of a Parabolic-Spheric Dish Based on Photographic Method <i>Roccabruna, M., Crema, L., Menna, F., Remondino, F.</i>	1055
Abrasion and Cleaning Tests on Antireflective and Antireflective/Antisoiling Coatings for Solar Glass Glazing <i>San Vicente, G., Farchado, M., Germán, N., Morales, Á.</i>	1063
Radiative Collector and Emitter: Experimental Results <i>Vall, S., Medrano, M., Solé, C.</i>	1071
Surface Modification of AISI 316 Stainless Steel by Oxynitrocarburizing for Solar Collector Applications <i>Vargas, G., Chávez, A.F., López, L.</i>	1077
Electroplating of Selective Surfaces for Concentrating Solar Collectors <i>Zäll, E., Mossegård, J., Nordenström, A., Wågberg, T.</i>	1086

Thermal Storage

Stratification in Large Thermal Storage Tanks <i>Battaglia, M., Haller, M.</i>	1097
Thermal Collection and Seasonal Storage Potential of a Mixed-Use Neighborhood <i>Hachem-Vermette, C., Cellura, M., Guarirno, F.</i>	1108
Experimental Study of a 600 w Seasonal Solar Heat Storage Reactor for the Heating of Buildings <i>Hennaut, S., André, P., Baiwir, R., Collard, L., Davin, E.</i>	1118
Sensible Thermal Energy Storage in Packed Bed for Industrial Solar Applications <i>Kocak, B., Paksoy, H.O.</i>	1130
Encapsulation of Inorganic Phase Change Materials by Sol-Gel Method for Thermal Energy Storage <i>Lucio, B., Romero, M.</i>	1137
Preliminary Results for the First Year of Operation of a Seasonal Storage Solar Combisystem for a Single Detached House <i>Meister, C., Beausoleil-Morrison, I.</i>	1144
Modeling and Validation of Different Heat Exchanger Geometries for Solar Ice Storage Systems <i>Paulini, S., Brüggemann, D., Plessing, T.</i>	1154
Validation of an Ice Storage Model and Its Integration Into a Solar-Ice System <i>Philippen, D., Battaglia, M., Carbonell, D., Kunath, L., Thissen, B.</i>	1162
Decentralized DHW Production from Exhaust Air in the Bathroom Prewall <i>Ruesch, F., Büchel, E., Haller, M., Persdorf, P., Urena, D.</i>	1174
Design and Evaluation of a Compact Thermal Storage System Using River Stones for a Continuous Drying Process of Agricultural Products in Peru <i>Tipula Ramos, R.R., Hadzich Marin, M.A., Herrera, E., Lopez Vasquez, E., Vergara Dávila, S.G.</i>	1181
Development of a Solar Paddy Dryer by Fluidization Technique Using Heat from a Solar Pond <i>Tundee, S., Rongchai, K.</i>	1189
High Temperature Seasonal BTES for Effective Load Shifting and CO₂ Emission Reduction <i>Weber, R., Baldini, L.</i>	1201
Semi Continuous Thermochemical Reactor for Thermal Storage <i>Wytttenbach, J., Descy, G., Descy, A.</i>	1210

Testing & Certification

Optical Properties of Solar Absorbers – Results on Round Robin and Guidelines <i>Carvalho, M.J., Bohren, A., Fischer, S., Loren, A., Nielsen, J.E., Páscoa, S., Sallaberry, F., Wilson, H.R.</i>	1223
In Situ Characterization of Thermal Collectors in Field Installations <i>Fahr, S., Gumbel, U., Kramer, K., Zirkel-Hofer, A.</i>	1231
Modelling the Relative Humidity Inside Flat Plate Collectors <i>Fischer, S., Marquez, F.</i>	1241

Comparative Analysis of Life-Cycle Assessment Tools (LCA) Using the Example of Different Energy Supply Variants of a Purpose-Built Building	
<i>Kastner, R., Reim, M., Weismann, S., Yu, Y.</i>	1253
Quasi-Dynamic Testing of a Novel Concentrating Solar Collector According to ISO 9806:2013	
<i>Kurdia, A., Gomes, J., Ollas, P., Olsson, O., Pius, G.</i>	1262
Comparison of Two Whole System Test Methods: CCT and PLPE	
<i>Menegon, D., Haberl, R., Haller, M.</i>	1274
Analysis of Applicability of PLPE Method for the Test of a Solar Cooling System	
<i>Menegon, D.</i>	1285
OTSun: An Open Source Code for Optical Analysis of Solar Thermal Collectors and PV Cells	
<i>Pujol-Nadal, R., Bonnín-Ripoll, F., Cardona, G., Hertel, J.D., Martínez-Moll, V.</i>	1295
Ageing Performance of New Solar Cover Materials After Outdoor Exposure	
<i>Ruesch, F., Brunold, S.</i>	1302
CFD-Based Development, Testing and Optimization of Flat Plate Collectors	
<i>Vetter, B., Drück, H., Fischer, S.</i>	1309

System Simulation (2nd SIGES Conference on the Simulation of Building-Integrated Energy Systems)

An Improved Model for Phase Change Material (PCM) Thermal Storage Tanks	
<i>Andrés Chicote, M., Sanz Jimeno, R.</i>	1322
Model Predictive Control for Building Automation	
<i>Bolt, P., Füchslin, R., Jaeger, C., Maier, O., Ritzmann, R., Zierbart, V.</i>	1330
Techno-Economic Evaluation of Energy Self-Sufficiency for the	
PIPE Network Analysis for Solar Thermal Plants	
<i>Eismann, R.</i>	1353
Dynamic Modelling of a Hybrid Solar Thermal/Electric Storage System for Application in Residential Buildings	
<i>Frazzica, A., Barz, T., Cabeza, L.F., Emhofer, J., Ferraro, M., Karellas, S., Orò, E., Palomba, V., Sergi, F., Varvagiannis, S., Zsembinszki, G.</i>	1364
Potential of Direct Solar Thermal Driven Absorption Heat Pump in Hybrid Systems	
<i>Gritzer, F., Neyer, D., Ostheimer, M., Thür, A.</i>	1376
Dynamic Modeling and Optimization of Energy Use in Retrofitted Buildings at District Heating Level	
<i>Iturralde, J., Chicote, M.A., Martín, J., Martín, E., Pascual, C., Urra, I., Vasallo, A.</i>	1387
BIM Use Case: Model-Based Performance Optimization	
<i>Jakobi, M., Stöckli, U., Witzig, A.</i>	1395
From Simulation to Reality: IEC 61499 Compliant Control Applications for Solar Energy Systems	
<i>Jakobi, M., Meier, L., Quaschnig, V., Stöckli, U., Tjaden, T.</i>	1403

Theoretical Analysis of Photovoltaic Panels Using a Spray Cooling System with a Shallow Geothermal Energy Heat Exchanger	
<i>Liang, J., Chen, S., Tseng, C., Yang, L.</i>	1413
BIM a Driver for Energy Transition and BIVP Adoption	
<i>Nguyen, V.K., Machado, M.</i>	1423
A Comparison of Stratified Heat Storage With and Without Modular PCM Storage Through Simulation	
<i>Pabst, V., Mengedoht, G., Renze, P.</i>	1433
Using Behavior Simulation to Synthesize Electromobility Charging Profiles	
<i>Pflugradt, N., Muntwyler, U.</i>	1445
Multiobjective Synthesis of a Polygeneration System for a Residential Building Integrating Renewable Energy and Electrical and Thermal Energy Storage	
<i>Pinto, E.S., Serra, L.M.</i>	1454
Quantifying the Potential of Smart Heat-Pump Control to Increase the Self-Consumption of Photovoltaic Electricity in Buildings	
<i>Stauffer, Y., Alet, P., Hutter, A., Koch, N., Pflugradt, N.</i>	1466
Integrating Polysun into a Test Bench for Prosumer Hardware	
<i>Wienands, S., Pflugradt, N.D., Vezzini, A.</i>	1475

Solar Resource and Energy Meteorology

A First Approach of the Influence of the Forecasting Horizon in the Electricity Generation Simulation of a Solar Tower Plant	
<i>Alonso-Montesinos, J.</i>	1482
Climatic and Global Validation of Daily MODIS Precipitable Water Data at AERONET Sites for Clear-sky Irradiance Modelling	
<i>Bright, J.M., Engerer, N.A., Gueymard, C., Killinger, S., Lingfors, D., Sun, X., Wang, P.</i>	1490
Brazilian Photovoltaic Potential	
<i>Bueno Pereira, E., Ramos Martins, F., Rodrigues Gonçalves, A., Santos Costa, R.</i>	1502
Assessing Solar Electricity Potential and Prospective Present Day Costs For A Low Latitude Caribbean Island: Trinidad	
<i>Dookie, N., Chadee, X.T., Clarke, R.M.</i>	1511
Accuracy of Solar Resource Assessments on the Basis of Publicly Available GHI Databases	
<i>Egler, M.</i>	1522
Solar Irradiation Over a Flat Surface with Different Tracking Strategies	
<i>Gonzalez-Cabrera, A.E., Arancibia-Bulnes, C., Estevez, H., Ramirez-Ramirez, A., Valdes-Barron, M., Zarzalejo, F.</i>	1532
Validation of Real-Time Solar Irradiance Simulations Over Kuwait Using WRF-Solar	
<i>Gueymard, C., Jimenez, P.</i>	1540
Progress in Sky Radiance and Luminance Modeling Using Circumsolar Radiation and Sky View Factors	
<i>Gueymard, C., Ivanova, S.</i>	1551

Most Probable Operating Conditions and Performance Assessment of Four PV Technologies at 10 Locations in India	
<i>Gupta, N.C., Das, P.K., Giridhar, G.</i>	1563
Short Term PV Forecasting Using Satellite Data for Austria	
<i>Kortschak, D., Feichtinger-Hofer, M., Kernitzky, M.</i>	1575
The Spatial and Temporal Patterns of the Surface Solar Irradiation in Northeastern Region of Brazil	
<i>Lima, F., Costa, R., Gonçalves, A., Martins, F., Pereira, E., Santos, A.P.</i>	1585
Regression by Integration applied to Angström-PreScott-type Relations	
<i>Morf, H.</i>	1597
Effect of Solar Position Calculations on Filtering and Analysis of Solar Radiation Measurements	
<i>Perez-Astudillo, D., Bachour, D., Martin-Pomares, L.</i>	1605
Urban Climate – Impact on Energy Consumption an Thermal Comfort of Buildings	
<i>Remund, J., Grossenbacher, U.</i>	1614
Evaluation of Solar Radiation from MERRA, MERRA-2, ERA-Interim and CFSR Reanalysis Datasets Against Surface Observations for Multan, Pakistan	
<i>Tahir, Z.u.R., Ahmad, S.U., Ali, M.J., Asim, M., Azhar, M., Hayat, N., Hussain, A.</i>	1624
Evaluation of NCEP-Products (NCEP-NCAR, NCEP-DOE, NCEP-FNL, NCEP-GFS) of Solar Radiation for Karachi, Pakistan	
<i>Tahir, Z.u.R., Ali, H., Asim, M., Azhar, M., Hayat, N., Shahid, H.</i>	1631
Monthly Solar Irradiance Variability in Brazilian Climate Zones	
<i>Weide Luiz, E., Bueno Pereira, E., Gonçalves de Souza, J., J. Lopes de Lima, F., Pizzuti Pes, M., Ramos Martins, F., Rodrigues Gonçalves, A., Santos Costa, R.</i>	1642

Solar Education

On the Importance of Education when Implementing Renewable Energy	
<i>Broman, L., Kandpal, T.C., Ott, A.</i>	1649
A Simple Tool for Assessing Solar and Daylight Access in Urban Canyons	
<i>Compagnon, R., Chatzipoulka, C.</i>	1655
Development of a Compact and Didactic Solar Energy Kit Using Arduino	
<i>Costeira, J., Cabral, D., Gomes, J., Hayati, A., Vieira, M.</i>	1663
Using Heliodon for Solar Building Design Education in the Age of Computer Simulations	
<i>Pajek, L., Božiek, D., Dovjak, M., Košir, M., Kuni, R., Potonik, J., Šubic, N.</i>	1668
Dialogue Between Research Solar Practices and Training Activities: Interactive Webinar by Integration of ICT in Education	
<i>Polo López, C.S., Frontini, F.</i>	1678
Understanding the Dynamics of Solar Energy Systems by Using Simulation Narratives	
<i>Witzig, A., Borth, J., Danesi, S.</i>	1687

Renewable Energy Strategies and Policies

Indoor Climate Agreements in Energy-Efficiency and Renovation Projects - A Question of Justice? <i>Henning, A.</i>	1694
Photovoltaics or Solar Thermal –The Winner Takes it All? <i>Muntwyler, U., Schuepbach, E.</i>	1704
Preliminary Economic Evaluation of the First Grid-Connected Photovoltaic System in the Aysén Region Under the Current Law of Distributed Generation in Chile <i>Osorio-Aravena, J.C., Muñoz-Cerón, E.</i>	1711
Accompanying Project Owners and Professionals All the Way to Secure Solar Thermal Plants <i>Porcheyre, E., Mugnier, D.</i>	1716
Research for Compiling a Mandatory National Standard Technical Code for Energy Efficiency in Buildings and Renewable Energy Application <i>Zheng, R., He, T., Li, B., Wang, M., Zhang, X.</i>	1722

Author Index

Index of all Authors	1729
-----------------------------------	------



Life Cycle Assessment experiences for solar heating and cooling systems

Marco Beccali¹, Maurizio Cellura¹, Maria Anna Cusenza¹, Sonia Longo¹, Daniel Mugnier², Tim Selke³ and Vicente Quiles Pedro Gines⁴

¹ University of Palermo - Department of Energy, Information Engineering and Mathematical Models (DEIM), Palermo (Italy)

² TECSOL, Perpignan (France)

³ AIT Austrian Institute of Technology GmbH, Vienna (Austria)

⁴ Universidad Miguel Hernandez, Elche (Spain)

Abstract

Solar heating and cooling systems can significantly contribute to the energy and climate European goals. A complete assessment of this contribution needs the analysis of these systems from a life-cycle perspective, in order to estimate the energy and environmental costs of their manufacturing and end-of-life, and to compare these costs with the benefits obtained during operation. A well-established methodology to fulfil this task is the Life Cycle Assessment (LCA). The paper describes some LCA experiences of solar heating and cooling systems, developed within the Task 53 “New generation solar cooling & heating systems (PV or solar thermally driven systems)” of the International Energy Agency. The results of these analyses can be useful to orientate manufacturers, researchers and decision makers for a more sustainable use of solar technologies.

Keywords: solar heating and cooling, life cycle assessment, sustainability, environmental impacts

1. Introduction

Solar heating and cooling (SHC) systems can significantly contribute to the energy and climate European goals (European Commission, 2014; European Commission, 2011) by reducing the use of fossil fuels and the related environmental impacts for building air-conditioning (Beccali et al., 2016; Bukoski et al., 2014; Longo et al., 2017).

The SHC systems mainly use energy from renewable sources during operation. However, they consume energy and cause environmental impacts during the whole life cycle (manufacturing, operation and end-of-life) (Beccali et al., 2014). Thus, to correctly assess the real benefits due to the installation of SHC technologies, their life cycle energy and environmental impacts should be estimated (Beccali et al., 2012a; Finocchiaro et al., 2016).

A useful tool to assess resource use, energy and environmental burdens related to the full life cycle of products and services is the Life Cycle Assessment (LCA) methodology (ISO, 2006a, 2006b).


In this paper, some experiences of LCA applied to SHC systems are described, developed within the Task 53 “New generation solar cooling & heating systems (PV or solar thermally driven systems)” of the International Energy Agency (IEA) (Mugnier et al., 2015).

2. Description of the examined systems

The SHC systems examined in this study are the following:

- a PV – air conditioner unit (S1);
- a PV cooling system based on an air to water compression chiller (working fluid: propane) (S2);
- a compact desiccant evaporative cooling system, called “Freescoo” (S3).

The system S1 is designed to operate by using the electricity produced by a photovoltaic plant. The main components of the PV – air conditioner system are the PV panels and the air conditioning unit (Fig. 1).

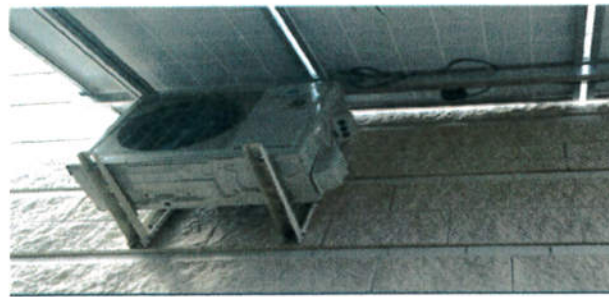

a) PV - Air conditioner: external unit



b) PV - Air conditioner: internal unit

Fig. 1: PV – air conditioner system

The system S2 is a PV cooling designed to operate by using the electricity produced by a photovoltaic power plant. The main components of S2 are the PV system, the heat pump and the chilled water circuit (Fig. 2).

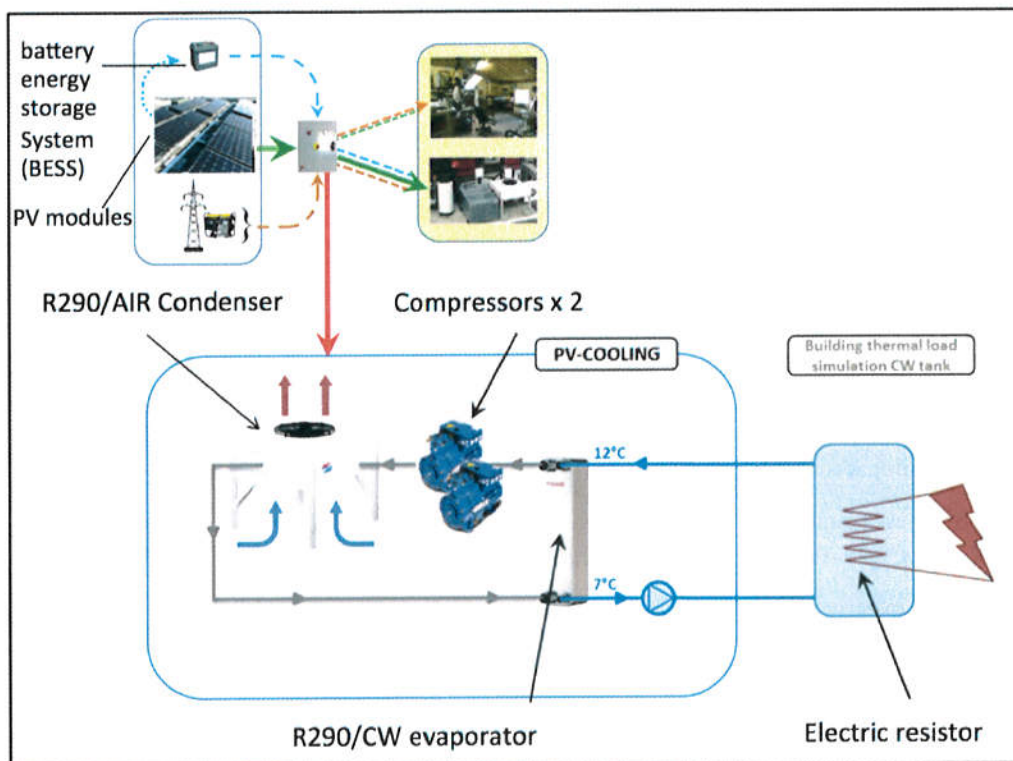


Fig. 2: PV – cooling system scheme

The system S3 (Fig. 3) is designed for air-conditioning in buildings and it is composed by a solar photovoltaic/thermal air collector, two adsorption beds, an integrated cooling tower, two wet heat exchangers, fans, batteries and all other auxiliaries needed to perform the air handling process also in stand-alone operation.



Fig. 3: Compact desiccant evaporative cooling system

3. Life Cycle Assessment of the three systems

The LCA is a standardized methodology widely adopted by the scientific community to assess the environmental impacts of products and services from a life cycle perspective (i.e. including extraction of raw materials, transports, manufacturing process, use and end-of-life) (ISO, 2006a, 2006b).

The LCA consists of four steps, briefly described in the following:

- Goal and scope definition. In this step the intended application(s) and the object of the study (i.e. the exact product or other system(s) to be analysed) are described and defined in detail (European Commission - Joint Research Centre - Institute for Environment and Sustainability, 2010). This step also includes the identification of system boundaries (unit processes that are part of a product system), functional unit (quantified performance of a product system for use as a reference unit), allocation procedures, selected impact categories and impact assessment methodologies, etc.
- Life Cycle Inventory (LCI) analysis. This step involves data collection and calculation procedures to quantify the resources consumption, the air, water and soil emissions, and the waste production.
- Life Cycle Impact Assessment (LCIA). This step is aimed at evaluating the significance of potential environmental impacts using the LCI result.
- Life cycle interpretation. In the final step of the LCA the results of a LCI and/or a LCIA are summarized and discussed as a basis for conclusions, recommendations and decision-making in accordance with the goal and scope definition.

The LCA methodology allows to capture the complexity hidden behind a product/service and to identify opportunities to improve its environmental performance at various phases of the life cycle preventing the risk to shift the impacts from one life cycle phase to another (i.e. from use phase to manufacturing one) and/or from one impact category to another.

3.1 Goal and scope definition

The goal of the study was to assess the energy and the environmental impacts caused by three different SHC systems and to highlight the potentials of the LCA methodology in evaluating the performance of this kind of systems in terms of impacts associated to a wide range of environmental categories.

The selected functional units (FUs) are:

- For the S1 system, the PV – air conditioner (FU_1);
- For the S2 system, the PV cooling (FU_2);
- For the S3 system, the FU is represented by a system with a useful life of 15 years that provides cooling and heating for the building, considering a cooling solar fraction of about 0.85 (FU_3).

The system boundaries include the manufacturing step for the S1 and S2 systems, while the whole life cycle was investigated for the last one, including the raw materials supply, the manufacturing of the system, its operation and end-of-life. The transports, installation and maintenance steps were not taken into account due to data unavailability. However, their impact on global energy consumption and the environment can be considered likely negligible (Kalogirou, 2009).

The following energy and environmental indexes are selected to illustrate the energy and the environmental performance of the examined system:

- Global energy requirement (GER);
- Global warming potential (GWP);
- Ozone depletion potential (ODP);
- Human toxicity, non-cancer effects (HT-ce);
- Human toxicity, cancer effects (HT-nce);
- Particulate matter (PM);
- Ionizing radiation, HH (IR-hh);
- Ionizing radiation, E;
- Photochemical ozone formation (POFP);
- Acidification (AP);
- Terrestrial eutrophication (T-EU);
- Freshwater eutrophication (F-EU);
- Marine eutrophication (M-EU);
- Freshwater ecotoxicity (F-E);
- Land use (LU);
- Water resource depletion (WRD);
- Mineral, fossil & renewable resource depletion (MFRRD).

The characterization models used for the impact calculations are the Cumulative Energy Demand (CED) (Frischknecht et al., 2007) method for the energy impacts, and ILCD 2011 Midpoint method for the environmental impacts (European Commission and Joint Research Centre, 2012).

The eco-profiles of materials and energy sources used to produce the main components of the analysed FUs are based on the Ecoinvent database (Frischknecht et al., 2005; Wernet et al., 2016) Impacts of end-of-life, only for FU₃, are calculated by using the following databases:

- Buwal 250 in the case of recycling (BUWAL250, 1998);
- Ecoinvent for landfilling (Frischknecht et al., 2005);
- Eth-Esu for the end of life of the solar panels (E.U.ESU Group, 1996);
- European Reference Life Cycle Database (ELCD) for the iron metals (Joint Research Center, 2016).

3.2 Life Cycle Inventory

This step was finalized to the first hand data collection (primary data) concerning the main inputs and outputs in terms of materials, components, energy sources and waste production. In addition, specific energy and environmental impacts (secondary data) of the above inputs and outputs were identified by using environmental databases (Wernet et al., 2016).

In the following, the authors describe the data collection related to each investigated SHC system.

Data collection – S1 system

The data are collected from the PV – air conditioner data sheet provided by the manufacturer.

The PV system consists of three modules made of polycrystalline silicon cells. The modules are connected in parallel. The nominal power of each panel is 235 W and the area 1.67 m². The PV modules are covered by a 3.3 mm tempered glass.

The air conditioner system has a cooling power of 3.7 kW and a heating power of 3.8 kW. The Seasonal Energy Efficiency Ratio (SEER) and the Seasonal Coefficient of Performance (SCOP) are, respectively, 7.5 (energy efficiency class A++ in cooling mode) and 4 (energy efficiency class A+ in heating mode).

Data collection – S2 system

The data are referred to the data sheet provided by the manufacturer. The PV system consists in 18 mono-

crystalline photovoltaic modules and in a battery energy storage system (BESS). The modules are connected in parallel. The nominal power of each panel is 280 Wp. The overall nominal capacity is 5.04 kWp. Each panel has an area of 1.62 m², a frame made of anodized aluminium and it is covered with a transparent tempered glass of 3.2 mm. The BESS is constituted by four lead acid batteries. The nominal energy capacity is 28.8 kWh.

The heat pump consists in:

- Two semi – hermetically compressors. The cooling power ranges from 2.38 to 5.38 kW. The Coefficient of Performance (COP) is 3.56.
- Refrigerant (Propane, R290);
- Refrigerant tank (2.8 l);
- Filter drier for refrigerant;
- Sight glass for refrigerant circuit;
- Electronic pressure switch;
- Low and high security pressure switch;
- Solenoid valves and coil for solenoid valves;
- An air-cooled condenser (micro-channel type condenser);
- An evaporator (brazed plate heat exchangers);
- A super-heater (brazed plate heat exchangers);
- Pump with a mass flow ranging from 2 to 12 m³/h;
- Expansion tank (steel);
- Electronic expansion valve;
- An effective circuit oil, including a filter drier, a sight glass for oil circuit, isolation valves for oil level regulation, a mechanical oil level regulator, an oil tank valve, an oil tank, an oil separator);
- Frame and various panels of the heat pump box.

The chilled water circuit consists in a 1000 l thermal storage tank and in a 200 l thermal storage tank with an electrical resistance to simulate the building loads (which was not considered in the inventory). Finally, a monitoring system is included to control the performance of the system. The chilled water consists in a mix of water and methyl propylene glycol (30% glycol).

Data collection – S3 system

Data were obtained from the direct measurement of the size and mass of each component and technical datasheets of each component of the system.

The data collection process involved the following equipments:

- Two adsorbent beds filled with silica-gel;
- Two Pb–Ca solar batteries, 12V - 65Ah;
- Air ducts connecting the evaporative cooling module and the evaporative tower;
- Electric components, including electric wires and junction boxes;
- Two 38 W circulation pumps;
- Solar photovoltaic panel (power 170W, height per length 1150mm*966mm) and solar thermal panel (aluminium based, TiNO_x coating (0.3 μm), and quartz glass (0.3 μm));
- Two electrovalves;
- Three polyester-based air filters;
- Ethylene propylene diene monomer (EPDM) thermal insulation;
- Evaporative cooling module, including hydraulics components and two heat evaporative heat exchangers;
- Galvanized steel bars utilized for the case;
- Fuse box;
- Control board with micro-controller governing all the electricity driven equipment;

- Servo-motor for rolling shading devices;
- Internal frame;
- Steel frame;
- Evaporative tower;
- Hydraulic components;
- Four ways air valve displaced among the two adsorbent beds;
- Two fans with 190 and 300 mm diameter.

In the operation phase (Tab.1-2) a heating period of 121 days and a cooling period of 90 days were considered to assess yearly impacts. Average monitored data are used to extrapolate seasonal performance for the whole heating (12 h a day) and cooling (8 h a day) season length. For the whole year, 113.4 kWh of total electricity consumption is considered for the yearly use phase calculation, of which only 24.9 kWh are imported from the grid. 2,590 l of water have been considered as well. A useful life of 15 years is expected for the system.

Tab. 1: Cooling season, use phase data for system S3

Consumption	Unit of measure	Value
Cooling energy delivered to the building	kWh/day	13.32
Electricity consumed (cooling mode)	kWh/day	1.04
Electricity from the grid (cooling mode)	kWh/day	0.26
Water consumption	l/day	28.78

Tab. 2: Heating season, use phase data for system S3

Consumption	Unit of measure	Value
Solar heat produced (including ventilation)	kWh/day	6.1
Electricity consumed (heating mode)	kWh/day	0.17
Electricity from the grid (heating mode)	kWh/day	0.01
Sensible heating energy delivered to the building	kWh/day	2.34
Water consumption	l/day	0

In the end-of-life phase it has been considered the recycling for glass based materials, landfill disposal for the solar PV/thermal modules and silica based components, rock wool and paints. No credit for recycling is associated to the end-of-life phase.

3.3 Life Cycle Impact Assessment: results and interpretation

In the following, the impacts on GER of each examined SHC system are indicated.

Concerning the S1 system, the GER of the PV – air conditioner manufacturing is $2.60E+04$ MJ_{primary} of which 86% is non – renewable primary energy. The PV panels manufacturing is responsible for the highest primary energy consumption. In detail, this component causes 88% of the GER (Fig. 4).

The GER of manufacturing phase of the PV – cooling unit (S2) is $2.86E+05$ MJ_{primary} of which 88% is non – renewable primary energy. The PV panels manufacturing and the chilled water circuit are responsible for the

highest primary energy consumptions (Fig. 5). In detail, they account, respectively, for 71% and 16% of the GER.

The impact on GER of the system S3 is $3.59E+04$ MJ_{primary}, of which 75.7% is caused during the construction phase, 11.2% during operation and the remaining 13.1% during the end-of-life (Fig. 6).

The environmental impacts associated to the examined SHC systems are shown in Tab. 3.

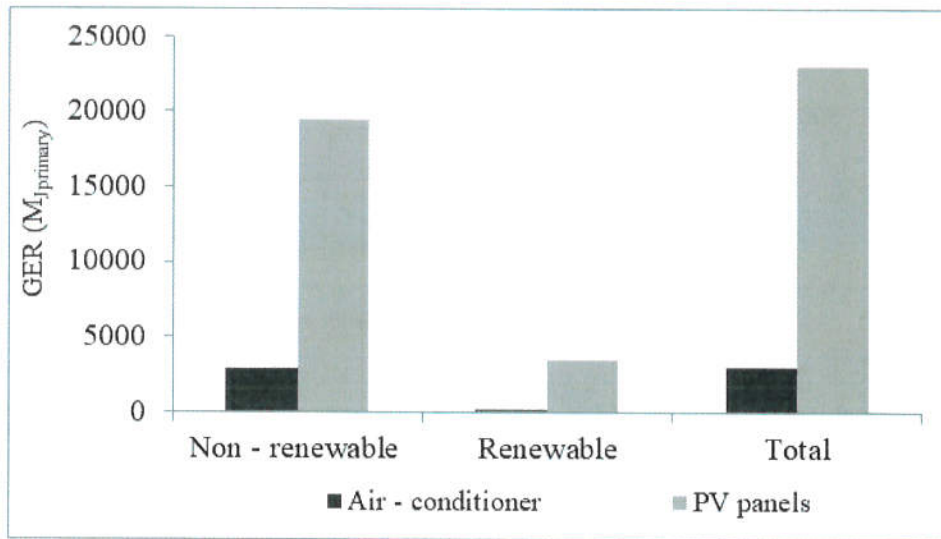


Fig. 4: GER processes contribution of the manufacturing phase – S1

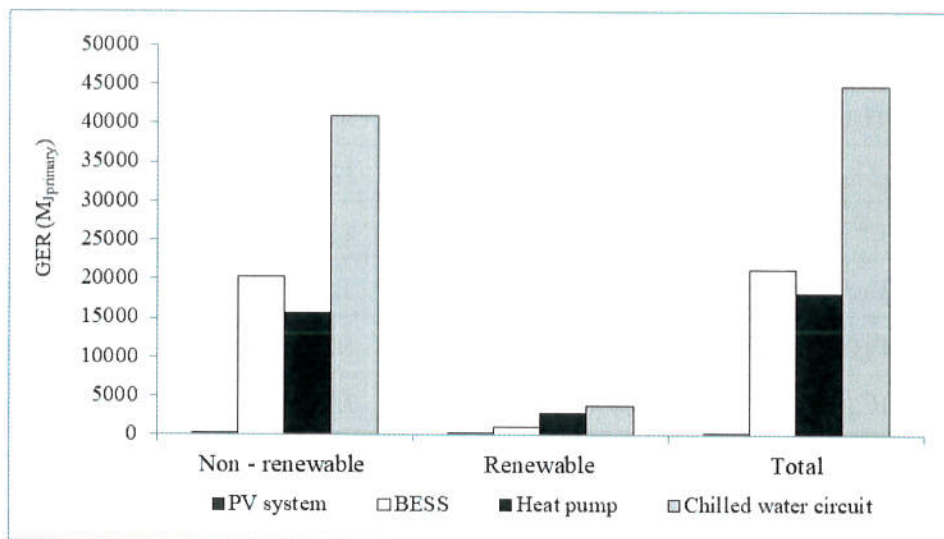


Fig. 5: GER processes contribution of the manufacturing phase – S2

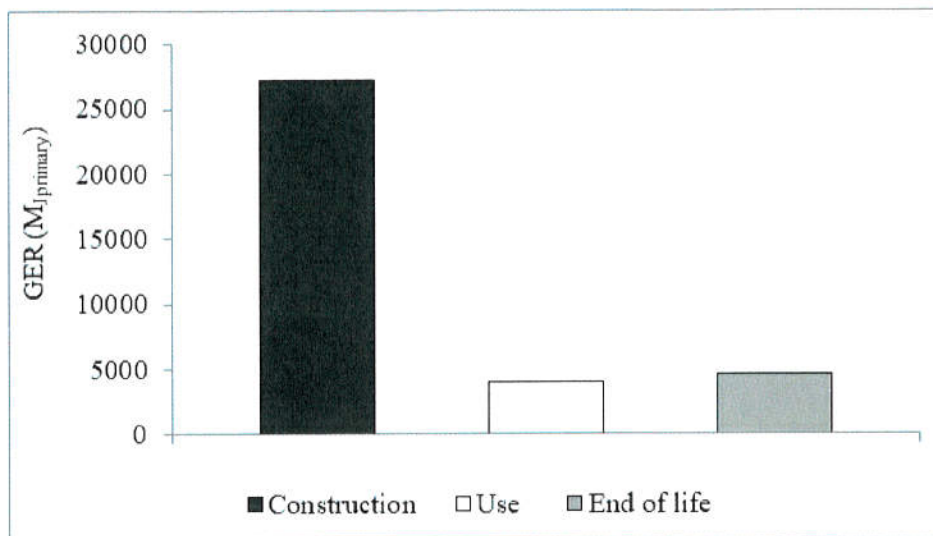


Fig. 6: GER processes contribution of each life cycle phase – S3

Tab. 3: Environmental impacts of the examined SHC systems

Impact category	S1	S2	S3
GWP (kg CO _{2eq})	1.87E+03	4.57E+03	2.15E+03
ODP (kg CFC-11 _{eq})	1.21E-02	1.28E-02	2.19E-04
HT-ce (CTUh)	2.66E-04	8.85E-03	7.10E-04
HT-nce (CTUh)	2.26E-03	2.22E-03	2.36E-03
PM (kg PM2.5 _{eq})	7.63E-01	5.43E+00	5.32E+02
IR-hh (kBq U ²³⁵ _{eq})	3.96E+02	4.91E+02	4.12E+02
IR-c (CTUe)	1.21E-03	1.59E-03	1.25E-03
POFP (kg NMVOC _{eq})	5.13E+00	1.71E+01	6.84E+00
AP (molc H ⁺ _{eq})	8.90E+00	3.74E+01	1.45E+01
T-EU (molc N _{eq})	1.43E+01	5.50E+01	2.22E+01
F-EU (kg P _{eq})	1.50E+00	5.76E+00	1.63E+00
M-EU (kg N _{eq})	1.50E+00	6.25E+00	2.13E+00
F-E (CTUe)	5.32E+04	2.30E+05	5.64E+04
LU (kg C _{deficit})	1.20E+03	9.07E+03	2.05E+03
WRD (m ³ water _{eq})	4.80E+03	8.87E+00	4.86E+03
MFRRD (kgSb _{eq})	6.35E-01	5.87E+00	3.13E-01

Fig. 7 shows the process contribution of the manufacturing phase of S1 on the examined impact categories. The highest impacts are observed for the PV panels in all the examined environmental categories, the only exception is the ODP for which the air conditioner manufacturing contribution is 98%, mainly related to the refrigerant R134a

production.

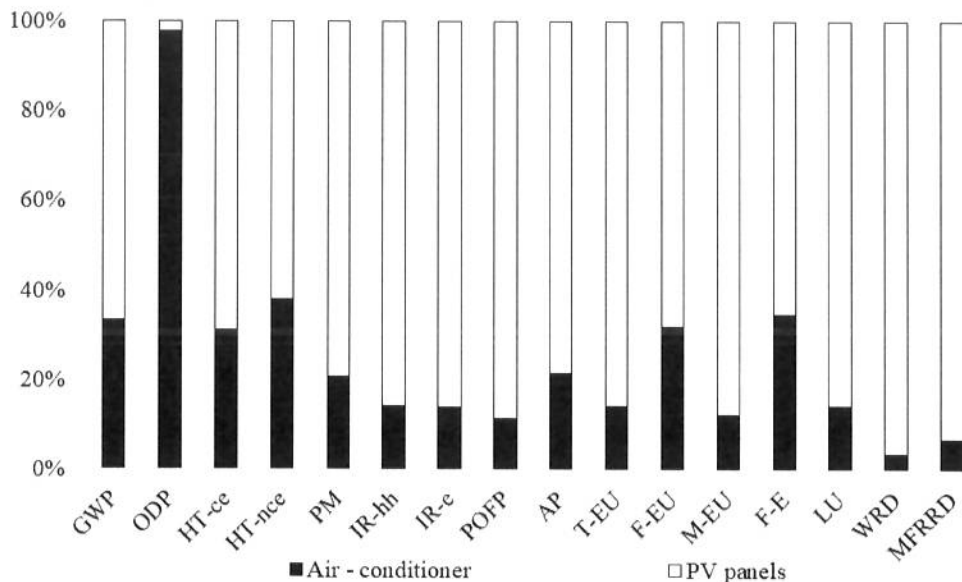


Fig. 7: Environmental impacts processes contribution – S1

Fig. 8 illustrates the contribution of each component of the S2 system to the examined impact categories. The PV panels account for the highest impact in all the examined impact categories. The only exceptions are the ODP and MFRRD, for which they represent about 12% and 40% of the overall impact, respectively. The contribution of the PV in the other impact categories ranges from 40.7% (for HT-ncc) to 93% (for WRD). The BESS contributions range from a minimum of about 0.9% in ODP up to 50.4% for MFRRD. The heat pump is responsible for the highest contribution to the ODP (about 86%) due to the refrigerant R134a production, used as a proxy for the refrigerant R290. The chilled water circuit gives an impact variable from 0.8% for ODP to 35.6% for HT-ncc.

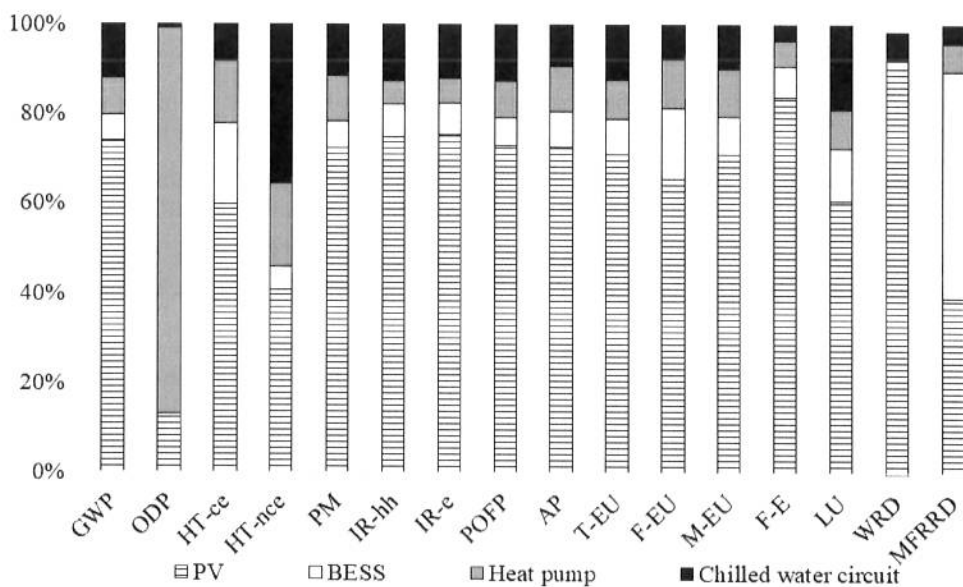


Fig. 8: Environmental impacts processes contribution – S2

With reference to the S3 system, Fig. 9 illustrates the share of each life cycle impact on the total impacts.

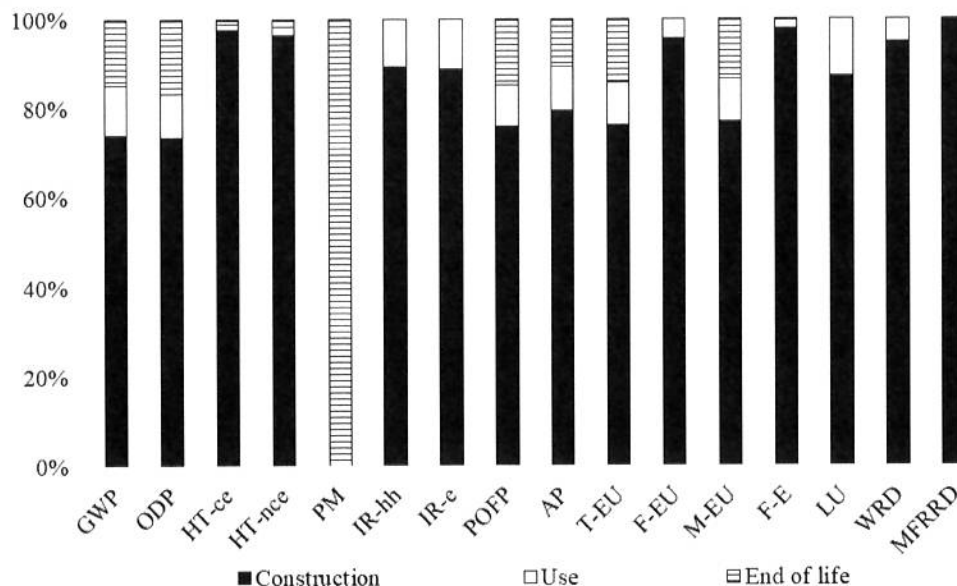


Fig. 9: Environmental impacts share of each life cycle phase – S3

The manufacturing phase has a predominant weight in most of the indicators, reaching values above or close to 95% in the case of the indicators WRD, F-E, F-EU, HT-nce, HT-cc. Moderately lower impacts are reported and always higher than 70% for all other impacts, the lowest being ODP at 73.55%. Since the manufacturing phase is largely the most relevant among all the others, some further insights will be discussed on this phase. The most impacting components are the adsorbent bed, the solar batteries, the PV/thermal system, the air filters, the evaporative cooling module, the external, internal and steel frames. The sum of the impacts for these components is higher than 85% of the total impacts for all the indicators, the only exception being ODP reaching 79.91%.

A detailed analysis of the manufacturing phase was carried out and the main outcomes are briefly discussed in the following bullet points:

- the highest share of impacts in DEC based processes is associated to the adsorbent beds, ranging from the 5.53% of the ODP and the 22.85% of the LU;
- for solar batteries the most relevant indicators are HT-nce (48.39%), F-EU (43.72%) and F-E (46.06%). The other indicators range between the 10.80% of the HT-cc to the 27.85% of the AP;
- the photovoltaic–thermal system impacts share varies between 13.27% of the indicator HT-nce and 21.67% of M-EU. HT-nce (7.73%), F-E (7.14%) and ODP (37.40%) are outside the overall trend;
- the air filters have a less relevant role, since their impact would range in most cases between the 4.35% (ODP) and 6.70% (GER). HT-nce, F-UE and F-E would fall below the lower threshold;
- the evaporative cooling modules impacts the total between the 9.18% of the POFP to the 13.19 of IR-e. Only some indicators, such as HT-nce (3.81%), F-EU (5.92%) and F-E (5.51%) are below 6%;
- in systems using PV collectors:
 - the external frames impacts are variable between the 3.18% of HT-nce to the 10.34% of HT-cc;
 - the internal frames result variation range is included between 3.48% of ODP and 7.08% of the GER;
 - the steel frames impacts vary between the 2% of WRD to the 5% of GWP. The only indicator outside the trend is the HT-cc, reaching the 10.87% of the overall impact.

4. Conclusions

The results of the LCA analyses allowed identifying the main energy and environmental “hot spots” to be taken into account for improving the environmental sustainability of the SHC systems. In detail, the results showed that the PV panels account for the highest impact caused during the manufacturing of the PV cooling system and the PV – air conditioner unit. The only exception is for ODP mainly caused by the heat pump (about 86%) in the first system and by the air conditioner (about 98%) in the second one. Referring to the compact desiccant evaporative cooling system (S3), the manufacturing step has a predominant weight in most of the impact categories, reaching values above or close 95% in the case of the freshwater ecotoxicity, freshwater eutrophication and human toxicity.

The most impacting components to the above impact categories are the solar batteries (about 40%).

The results of the research can represent a “knowledge basis” to assess the real advantages arising from the installation of SHC technologies for reducing the energy and environmental impacts of buildings air-conditioning and to orientate manufacturers, researchers and decision makers for a more sustainable use of solar technologies.

5. References

- Beccali, M., Cellura, M., Longo, S., Nocke, B., Finocchiaro, P., 2012a. LCA of a solar heating and cooling system equipped with a small water-ammonia absorption chiller. *Sol. Energy* 86, 1491–1503. <https://doi.org/10.1016/j.solener.2012.02.010>
- Beccali, M., Cellura, M., Longo, S., Nocke, B., Finocchiaro, P., 2012a. LCA of a solar heating and cooling system equipped with a small water-ammonia absorption chiller. *Sol. Energy* 86, 1491–1503. <https://doi.org/10.1016/j.solener.2012.02.010>
- Beccali, M., Finocchiaro, P., Nocke, B., 2012b. Energy performance evaluation of a demo solar desiccant cooling system with heat recovery for the regeneration of the adsorption material. *Renew. Energy* 44, 40-52. <https://doi.org/10.1016/j.renene.2011.12.021>
- Beccali, M., Cellura, M., Finocchiaro, P., Guarino, F., Longo, S., Nocke, B., 2014. Life Cycle performance assessment of small solar thermal cooling systems and conventional plants assisted with photovoltaics. *Sol. Energy* 104, 93-102, <https://doi.org/10.1016/j.solener.2013.10.016>
- Beccali, M., Cellura, M., Longo, S., Guarino, F., 2016. Solar heating and cooling systems versus conventional systems assisted by photovoltaic: Application of a simplified LCA tool. *Sol. Energy Mater. Sol. Cells* 156, 92–100. <https://doi.org/10.1016/j.solmat.2016.03.025>
- Bukoski, J., Gheewala, S.H., Mui, A., Smead, M., Chirattananon, S., 2014. The life cycle assessment of a solar-assisted absorption chilling system in Bangkok, Thailand. *Energy Build.* 72, 150-156. <https://doi.org/10.1016/j.enbuild.2013.12.034>
- BUWAL250, 1998. Bundesamt für Umwelt, Wald und Landschaft, Ökoinventar für Energie systeme, Berne, Switzerland.
- E.U.ESU Group, 1996. ETH-ESU96 Okoinventare von Energie systemen.
- European Commission, 2014. A policy framework for climate and energy in the period from 2020 to 2030. <https://Ec.Europa.Eu/Energy/En/Topics/Energy-Strategy/2030-Energy-Strategy> Brussels.
- European Commission, 2011. COMMUNICATION FROM THE COMMISSION: A Roadmap for moving to a competitive low carbon economy in 2050. COM(2011) 112 Final 34, 1–34.
- European Commission - Joint Research Centre - Institute for Environment and Sustainability, 2010. International Reference Life Cycle Data System (ILCD) Handbook - General guide for Life Cycle Assessment - Detailed guidance. First edition March 2010. EUR 24708 EN. Luxembourg. Publications Office of the European Union; 2010.
- European Commission, Joint Research Centre, 2012. Characterisation factors of the ILCD Recommended Life Cycle Impact Assessment methods: database and supporting information, European Commission.
- Finocchiaro, P., Beccali, M., Cellura, M., Guarino, F., Longo, S., 2016. Life Cycle Assessment of a compact Desiccant Evaporative Cooling system: The case study of the “Freescop.” *Sol. Energy Mater. Sol. Cells* 156, 83–91. <https://doi.org/10.1016/j.solmat.2016.03.026>
- Frischknecht, R., Jungbluth, N., Althaus, H., Bauer, C., Doka, G., Dones, R., Hischier, R., Hellweg, S., Köllner, T., Loerincik, Y., Margni, M., 2007. Implementation of Life Cycle Impact Assessment Methods. *Am. Midl. Nat.* 150, 1–151.
- Frischknecht, R., Jungbluth, N., Althaus, H.J., Doka, G., Dones, R., Heck, T., Hellweg, S., Hischier, R., Nemecek, T., Rebitzer, G., Spielmann, M., 2005. The ecoinvent database: Overview and methodological framework. *Int. J. Life Cycle Assess.* 10, 3–9.
- ISO, 2006a. ISO 14040: Environmental management — Life Cycle Assessment — Principles and Framework, International Organization for Standardization.
- ISO, 2006b. ISO 14044: Environmental management — Life cycle assessment — Requirements and guidelines, International Organization for Standardization.
- Joint Research Center, 2016. EPLCA – European Reference Life-Cycle Database. (<http://eplca.jrc.ec.europa.eu/ELCD3/index.xhtml>).

- Kalogirou, S., 2009. Thermal performance, economic and environmental life cycle analysis of thermosiphon solar water heaters. *Sol. Energy* 83, 39–48. <https://doi.org/10.1016/j.solener.2008.06.005>
- Longo, S., Palomba, V., Beccali, M., Cellura, M., Vasta, S., 2017. Energy balance and life cycle assessment of small size residential solar heating and cooling systems equipped with adsorption chillers. *Sol. Energy* 158, 543-558. <https://doi.org/10.1016/j.solener.2017.10.009>
- Mugnier, D., Fedrizzi, R., Thygesen, R., Selke, T., 2015. New Generation Solar Cooling and Heating Systems with IEA SHC Task 53: Overview and First Results. *Energy Procedia* 70, 470-473. <https://doi.org/10.1016/j.egypro.2015.02.149>
- Samuel, D.G.L., Nagendra, S.M.S., Maiya, M.P., 2013. Passive alternatives to mechanical air conditioning of building: A review. *Build. Environ.* 66, 54-64. <https://doi.org/10.1016/j.buildenv.2013.04.016>
- Santamouris, M., Kolokotsa, D., 2013. Passive cooling dissipation techniques for buildings and other structures: The state of the art. *Energy Build.* 57, 74-94. <https://doi.org/10.1016/j.enbuild.2012.11.002>
- Wernet, G., Bauer, C., Steubing, B., Reinhard, J., Moreno-Ruiz, E., Weidema, B., 2016. The ecoinvent database version 3 (part I): overview and methodology. *Int. J. Life Cycle Assess.* 21, 1218–1230. <https://doi.org/10.1007/s11367-016-1087-8>